
技术要求

1. 液压缸，旋转油密封与主轴同轴度公差0.02
2. 叶片按计算机程序分布结果对号安装。
3. 图示位置为叶片角度32.5° 时（行程50%）各部件位置。

Technical requirement

1. Hydraulic cylinder, tolerance of coaxiality between rotating oil seal and shaft is 0.02.
2. Blades are mounted according to the computer program distrubitim result (number correspound)
3. This picture shows the blade openning 50% (blade angle is 32.5°)

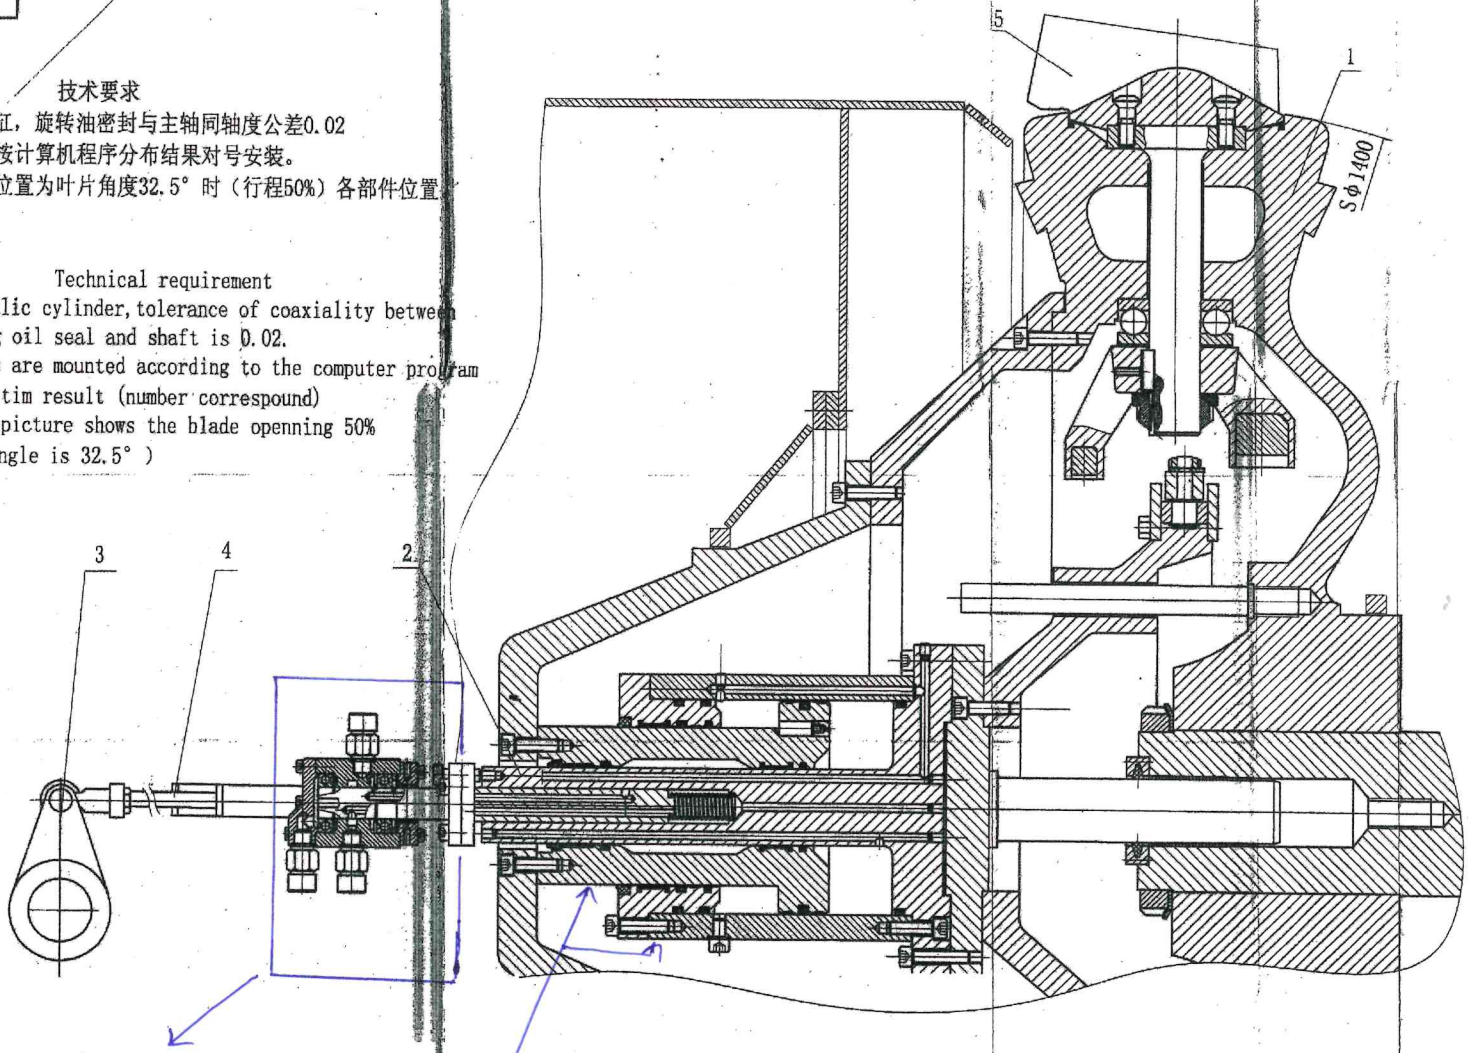

ADANI POWER PRIVATE LIMITED MUNDRA THERMAL POWER PROJECT 2 x 330 MW MUNDRA, KUTCHH DIST., GUJARAT, INDIA.				ROTOR	ASSEMBLY
FICHTNER Consulting Engineers (India) Private Limited Channal	MK	QTY.	DOC NO.	CORR'Y	DATE
	DES			AUDIT	
	DRAW			TECH.	
SICHUAN MACHINERY & EQUIPMENT IMP.&EXP. CO., LTD	CHK			APP.	
	STD			DATE	2007/8

SHENYANG BLOWER VENTILATING CO.,LTD

WEIGHT 972.5 | SCALE

PAGE 1 OF 1

305.25H